



SB-46

SMOKE DETECTOR BASE



P/N 18637

Electrical: 24 VDC Polarized
Mounting: 3 1/4" or 4" outlet box
Annunciator Output: 15 mA at 24VDC
Alarm Current: 46 mA @ 24 VDC
Service Use: NFPA 72 - National Fire Alarm Code



Application

The SB-46 Smoke Detector Base is a 6" polarized base with annunciator output featuring a current limiting resistor, and a blocking diode to enhance annunciator function. The SB-46 Smoke Detector Base is designed specifically for use with the Janus Fire Systems® Smoke Detector Models IS-24, and PS-24.

Fires from explosions, improperly stored flammable liquids, escaping gas, arson or fires resulting from inadequate fire protection practices may not be detected.

Smoke detectors should be tested upon completion of installation and at least semiannually thereafter, in accordance with the section of "Inspections, Tests, and Maintenance" in NFPA 72.

To Install the Detector: Insert the detector into the base, turn the detector clockwise until it locks, then tighten the vandal resistant allen screw.

WARNING


These detectors will not work without power. They must be properly connected into the signal initiating device circuit of a fire control panel that is listed as being compatible by Underwriters Laboratories, Inc.

These detectors will not sense fires which start where smoke does not reach the detector.

Fires on other building levels, within walls, on roofs, in chimneys, or on the other side of closed doors may not be detected.

CAUTION

These units must be installed and maintained in accordance with all applicable NFPA standards, local codes and any authority having jurisdiction. Please refer to NFPA 72 - Standards for Automatic Fire Detectors for installation guidelines and testing procedures.

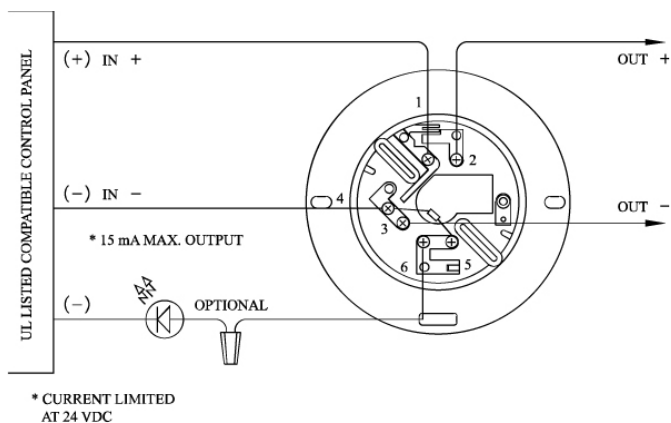

Terminal #	Designation
1	Positive In
2	Positive Out
3	Negative Out
4	Negative In
5	Annunciator Out
6	Annunciator Out

Ordering Information

Model	P/N	Description	Compatibility
SB-46	18637	Smoke Base 46 mA draw @ 24 VDC	Janus Fire Systems [®] Releasing Panel

Note: Approvals/Listings maintained by and manufactured by Potter Electric Signal Company.

The seller makes no warranties, express or implied, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose, except as expressly stated in the seller's sales contract or sales acknowledgment form. Every attempt is made to keep our product information up-to-date and accurate. All specific applications cannot be covered, nor can all requirements be anticipated. All specifications are subject to change without notice.



1102 Rupcich Drive
 Millennium Park
 Crown Point, IN 46307
 TEL: (219) 663-1600 FAX: (219) 663-4562
 e-mail: info@janusfiresystems.com
www.janusfiresystems.com