




CA-6075

CLASS A EXPANDER MODULE

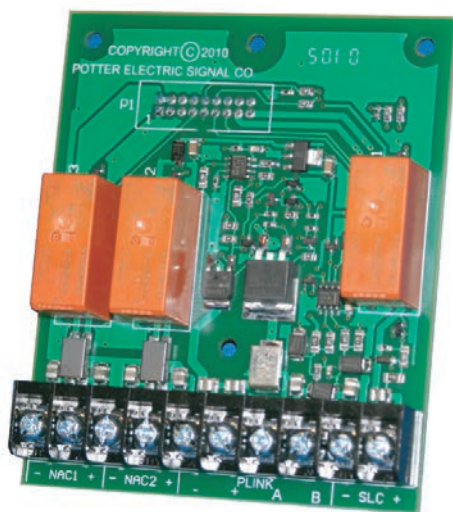

Features

- Standby Current 12 mA
- Alarm Current 44 mA
- Ambient Operating Temperature
0°C-49°C (32°F-120°F) 10%-93% @ 30°C (86°F)
non-condensing humidity
- Provides Class connection for SLC, NACs, & PLink.



P/N 99247

Description

The CA-6075 is a Class A Expander for the JFS-A1 addressable fire control panel. The CA-6075 allows for Class A wiring of the built in SLC circuit, P-Link communication bus and the two (2) built in NAC circuits. The CA-6075 mounts to the provided framework in the JFS-A1 panel.


Installation

Connection of the CA-6075 Class A Expander to the JFS-A1 Control Panel:

1. Remove two (2) #6-32x7/8 screws from the JFS-A1 and retain for use in step #3.
2. Install 5050793 Bracket, inserting end tabs into slots on the JFA-A1 User Interface bracket.
3. Secure 5050793 bracket to the JFS-A1 using the two (2) screws that were removed in step #1.
4. Slide the CA-6075 Class A Expander over the two (2) guide pins on the 5050793 bracket. Seat the CA-6075 on the 5050793 bracket so the connector on the back of the CA-6075 is fully engaged with the connector on the JFS-A1.
5. Secure the CA-6075 to the 5050793 bracket using two (2) #6-32x1/4 screws provided.




CA-6075 Class A Installation Diagram

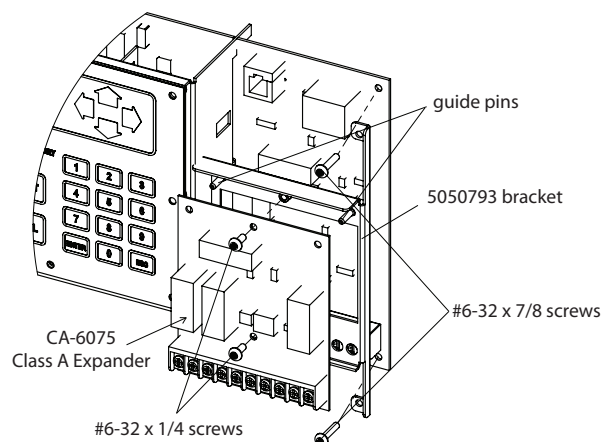

Refer to the PFC-6075 Installation and Programming manual for wiring Class A circuits

Installed Class A Card

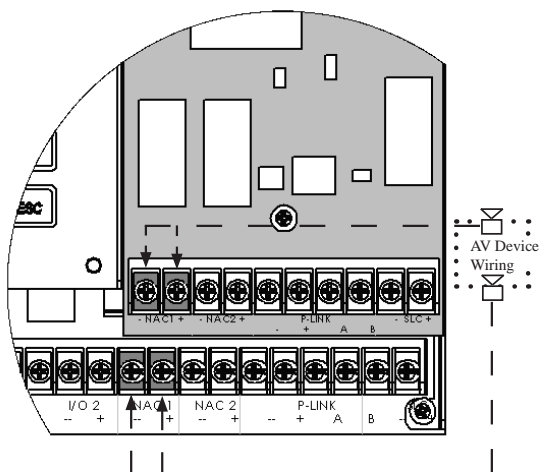

Note: Approvals/Listings maintained by and manufactured by Potter Electric Signal Company.

The seller makes no warranties, express or implied, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose, except as expressly stated in the seller's sales contract or sales acknowledgment form. Every attempt is made to keep our product information up-to-date and accurate. All specific applications cannot be covered, nor can all requirements be anticipated. All specifications are subject to change without notice.



1102 Rupcich Drive
 Millennium Park
 Crown Point, IN 46307
 TEL: (219) 663-1600 FAX: (219) 663-4562
 e-mail: info@janusfiresystems.com
www.janusfiresystems.com